

NC 309
3 of 3


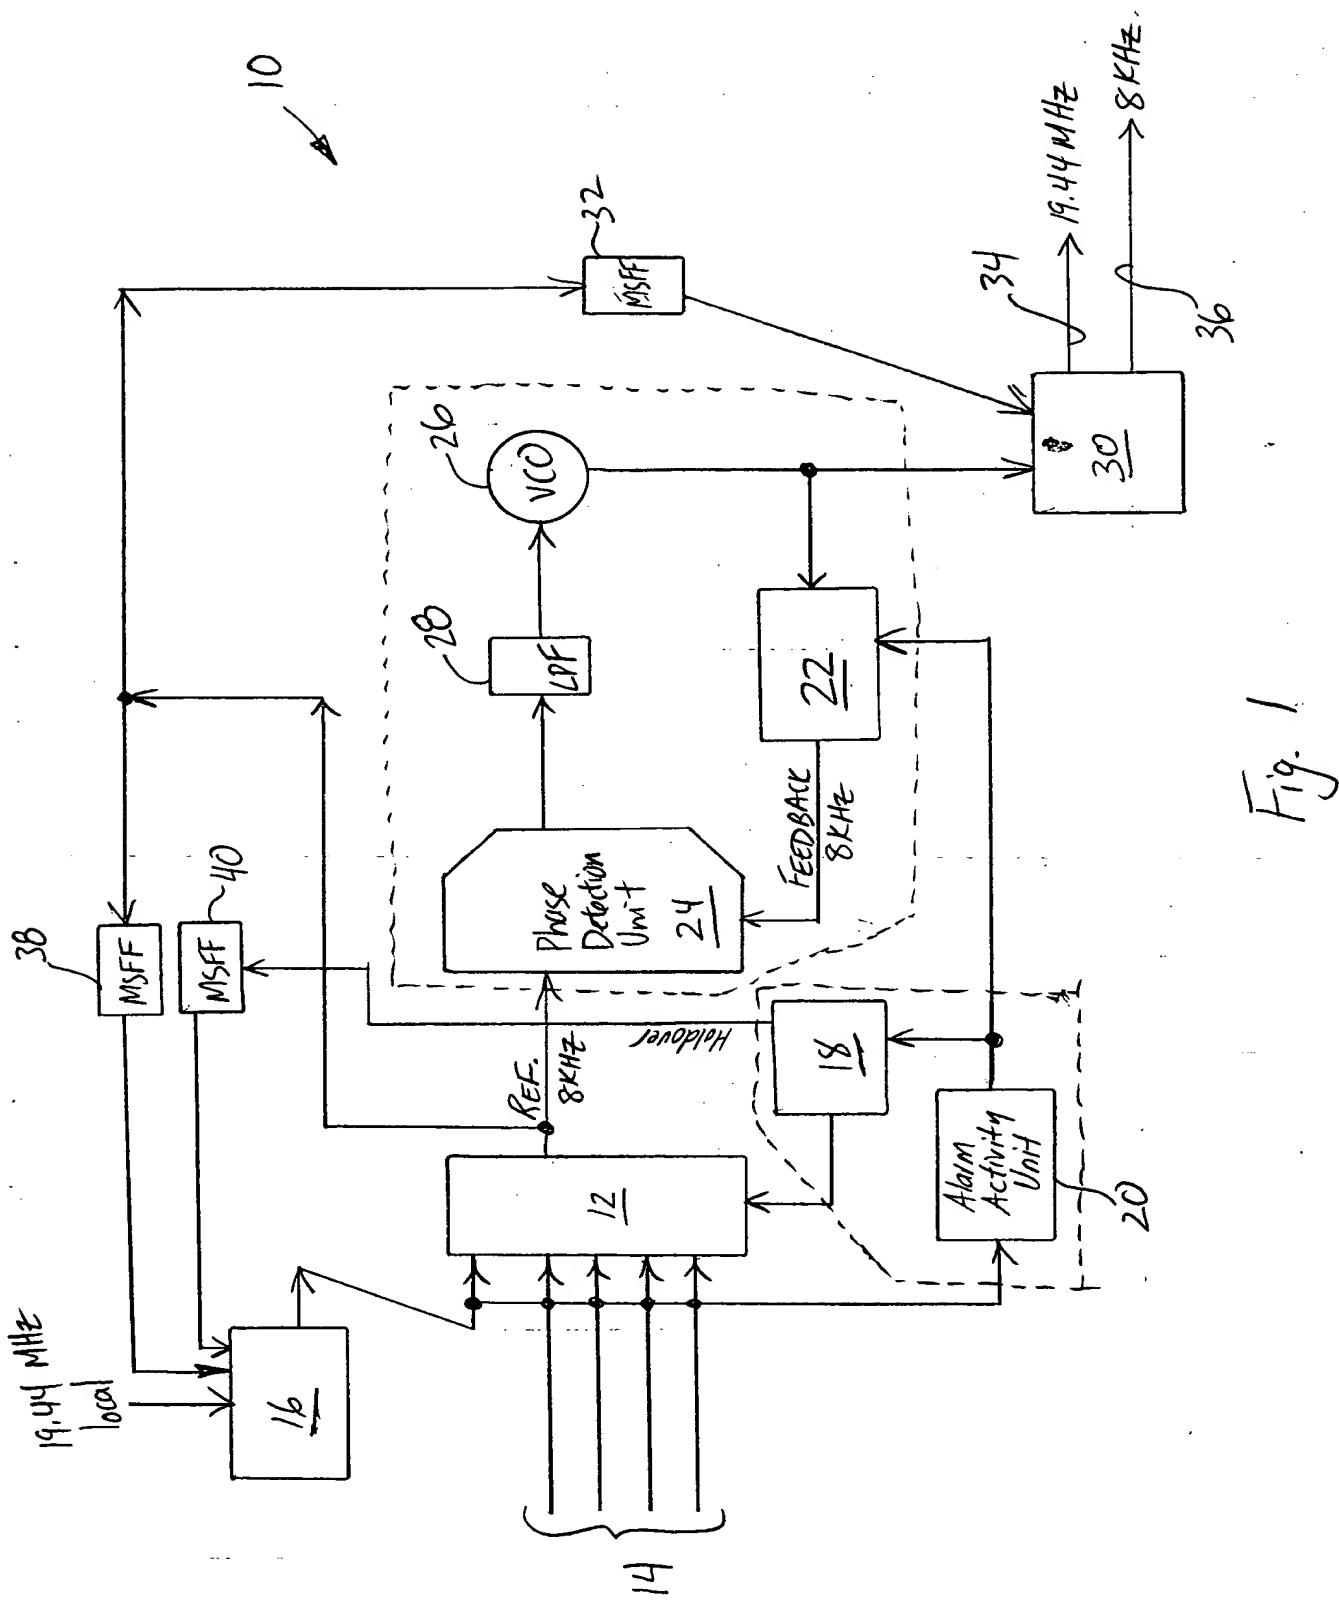


Fig. 1

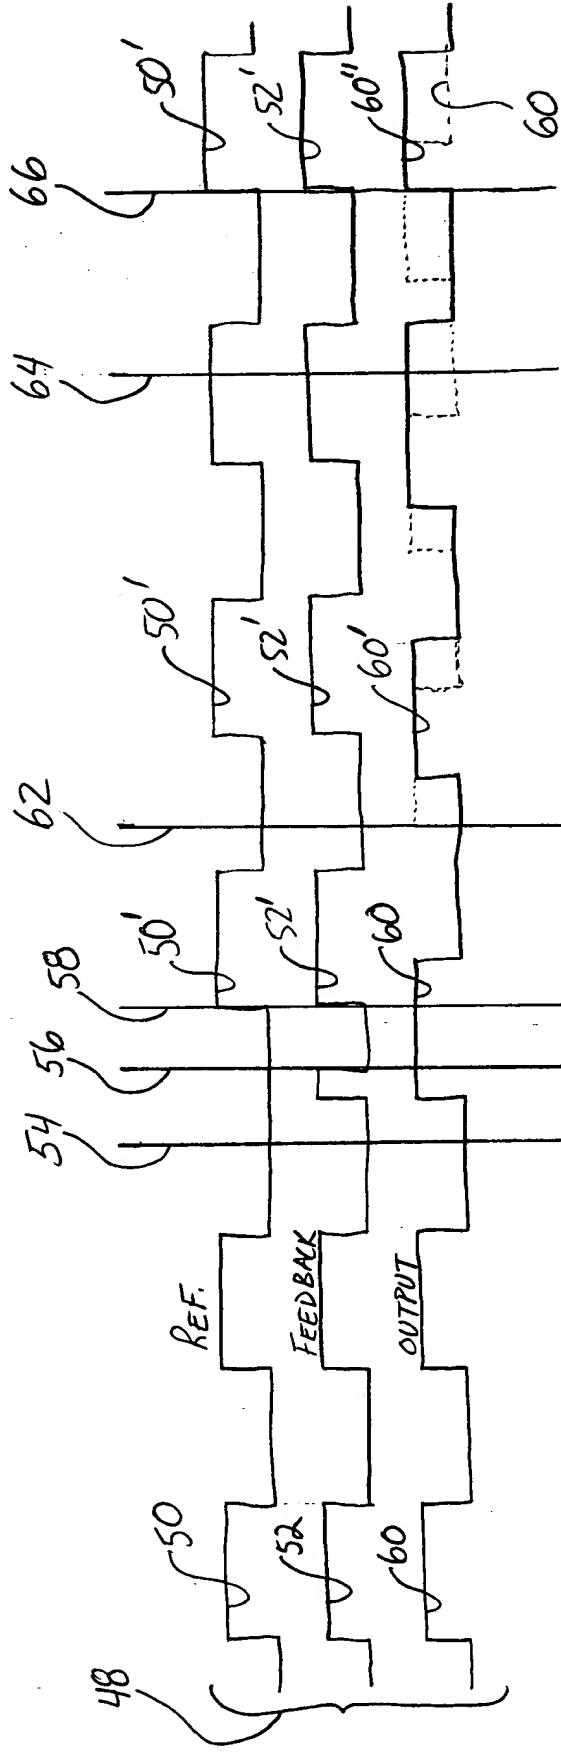

NC 30309
2 of 3.

Fig. 2

NC 30509
1 of 3

primary alarm = 0
secondary alarm = 0

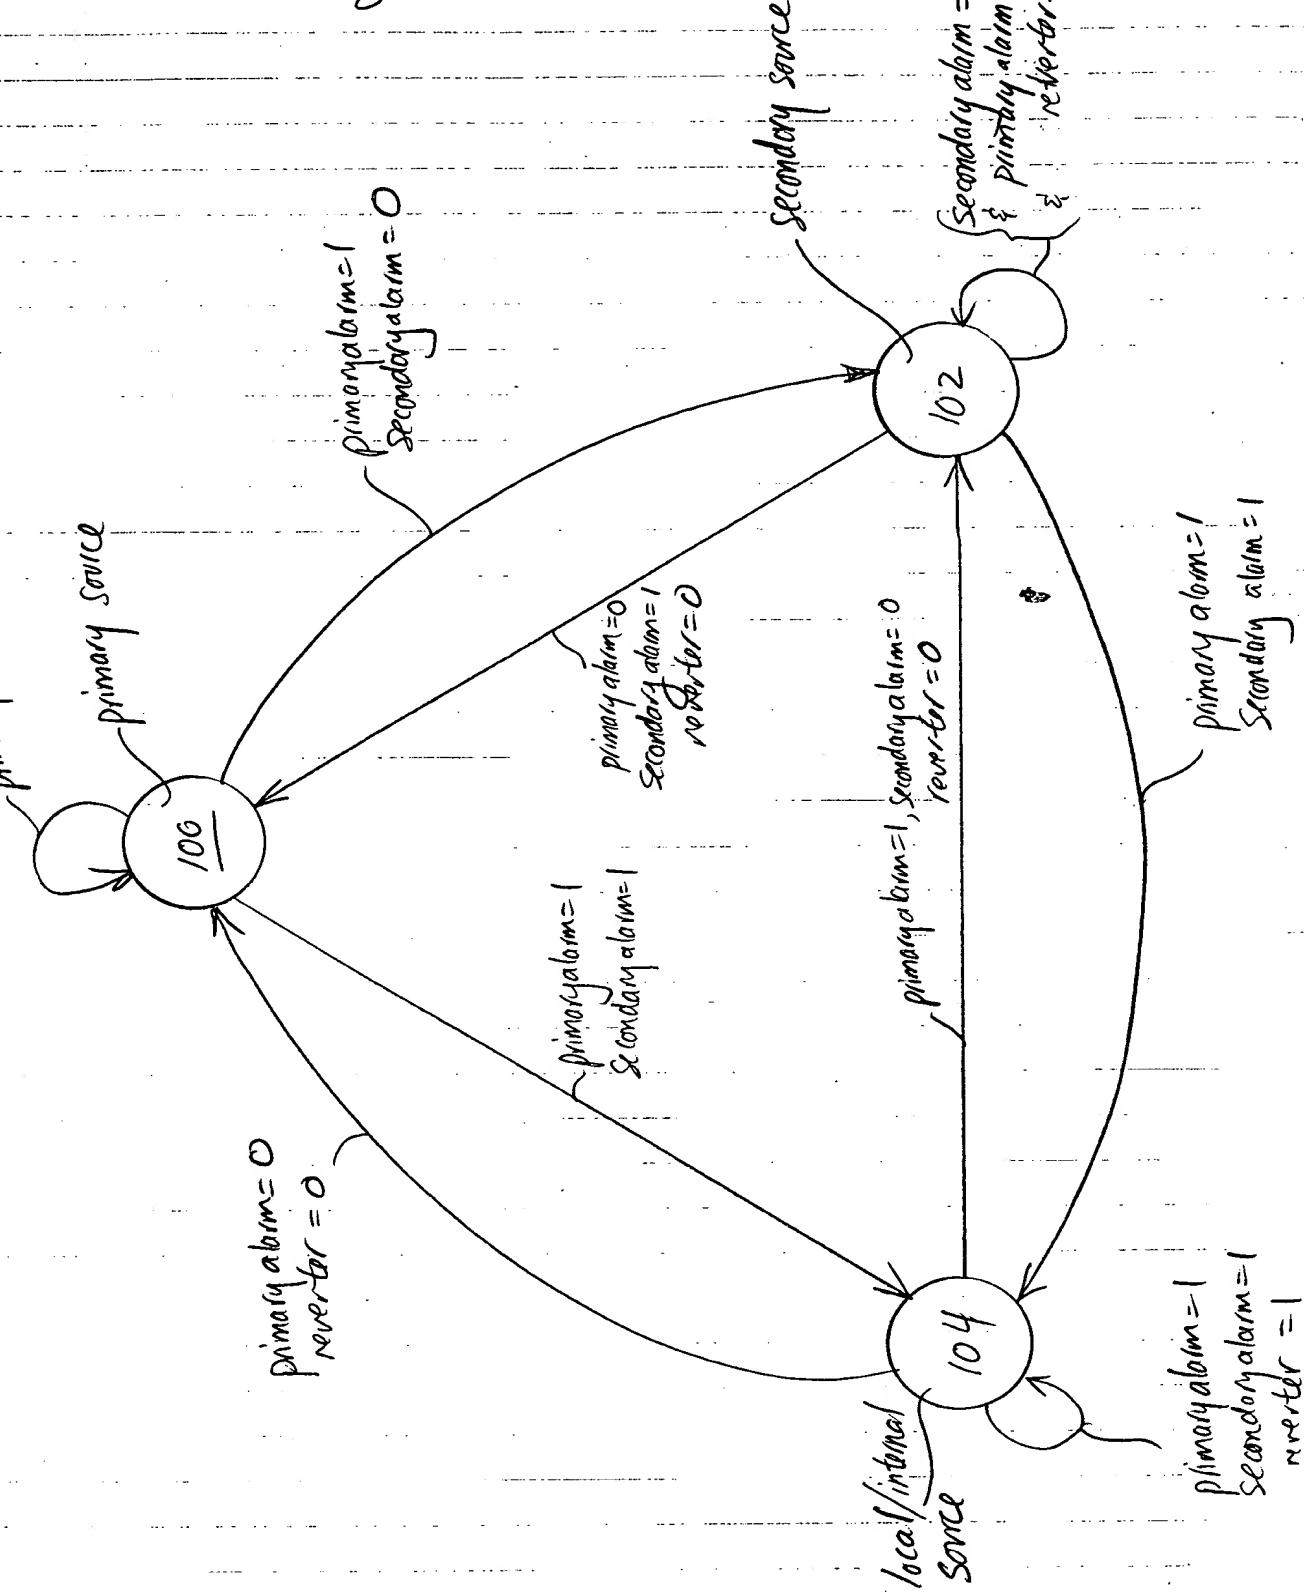


Fig. 3